

CONTROL CHART

REMOTE CONTROL CENTER

ALARM	◆	◆
INDICATION		◆
CONTROL	◆	◆
MEASURING		◆
ADJUSTMENT	◆	◆

Modbus

CONTROL CENTER OF THE UNIT

10 A 230V 50Hz GROUP CENTER

3x1,5

3x1,5

3x0,8

3x0,8



2x0,8

2x0,8

MODULAR CABLE
RJ12 10M

2x0,8

HK

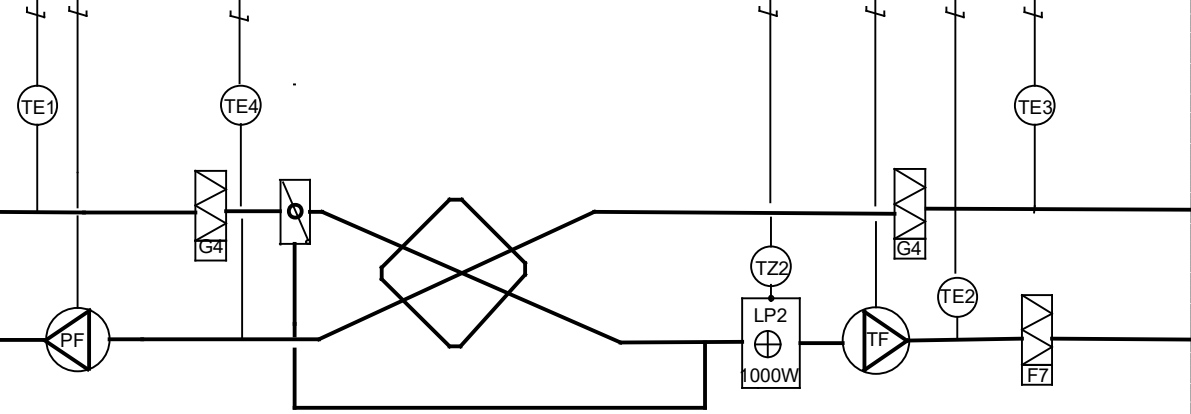

- HS
- T
- TK
- RH
- CO2

HS	CONTROL PANEL
EC	COOKER HOOD 0-10 V
T	BOOSTING SWITCH
TK	FIREPLACE/EXTENDED TIME SWITCH
RH	HUMIDITY TRANSMITTER
CO2	CARBON DIOXIDE TRANSMITTER

COOKER HOOD EC

VENTILATION ZONE

TE1	TEMPERATURE SENSOR OUT
TE2	TEMPERATURE SENSOR SUPPLY
TE3	TEMPERATURE SENSOR EXHAUST
TE4	TEMPERATURE SENSOR EXTRACT
TF1	SUPPLY FAN
PF2	EXTRACT FAN
LP2	POSTHEATING COIL
TZ2	OVERHEAT PROTECTOR POSTHEATING
FG1	SUMMER BYPASS DAMPER

SUPPLY DEMARCATION OF THE VENTILATION UNIT

VENTILATION UNIT DIVK-290 DEMA